

#### General Notes

Public areas were surveyed in the building.  
Access to all the flats was not possible.

Footprint shown is assumed, the areas not surveyed cannot be relied upon unless checked onsite for accuracy.

Plans are for illustration purposes only and should not be relied upon for any works carried out or for area calculation or building works.


#### Key:

##### FIRE DOOR SIGNS AND FIRE ACTION NOTICES

- FAN Fire Action Notice
- KS \*FIRE DOOR KEEP SHUT\* sign
- KL \*FIRE DOOR KEEP LOCKED\* sign
- KC \*AUTOMATIC FIRE DOOR KEEP CLEAR\* or \*FIRE EXIT KEEP CLEAR\* sign.
- LAN \*CAUTION, IN THE EVENT OF FIRE DO NOT USE THIS LIFT\*

##### FIRE PRECAUTIONS LEGEND

- Break glass type fire alarm call point.
- HD Point type heat sensitive detectors.
- SD Smoke sensitive detectors.
- SDR Smoke detectors in roof space.
- F Flashing Strobe Indicator.
- FAP Fire alarm indicator / repeat panel.
- Electromagnetic hold open devices
- FD20 20 minute Fire resistant door (FD20).
- FED Fire resistant flat entrance door.
- FD30S Self-closing half-hour fire resisting door. (FD30S).
- FD60S Self-closing one hour fire resisting. (FD60S).
- AOV Doors activated by the fire alarm system or in the event of power failure to work as Automatic Opening vent
- DEL Digital electronic lock door entry/exit system
- GH13 Door/Access fitted with Gerda H13 Key lock.
- GH36 Door/Access fitted with Gerda H36 Key lock.
- EL Fire alarm sounder. (X indicates integral flashing Xenon light.)
- EL Emergency light point.
- FES FIRE EXIT SIGNAGE
- E 'E' Signs to be externally illuminated by emergency light point.
- FE 'FE' denotes as previous but illuminated as part of sign.
- RM 'RM' denotes non illuminated sign
- B 1.1m x 1.1m fire blankets. Base of fire blanket container to be 1500mm above floor level.
- AF6 6 litres AFFF aqueous foam extinguisher to BS:6575
- C9 9 litre wet chemical type extinguisher.
- DP4.5 4.5 litre dry powder type extinguisher.
- CO2.5 4.5 kg carbon dioxide type extinguisher.
- W9 9 kg water type extinguisher.
- FS Firemans Switch
- DKA Emergency Drop Key Access
- CW Compartment Walls
- SVC Smoke Vent control panel
- POV Permanently Open Vent
- PIB Premises Information Box
- CCTV CCTV Security Camera
- AOV AOV Automatic Opening Vent
- AOV AOV Override Switch
- SPP Sprinkler Control Panel
- FL Firefighters Lift
- SSV Sprinkler Stop Valve

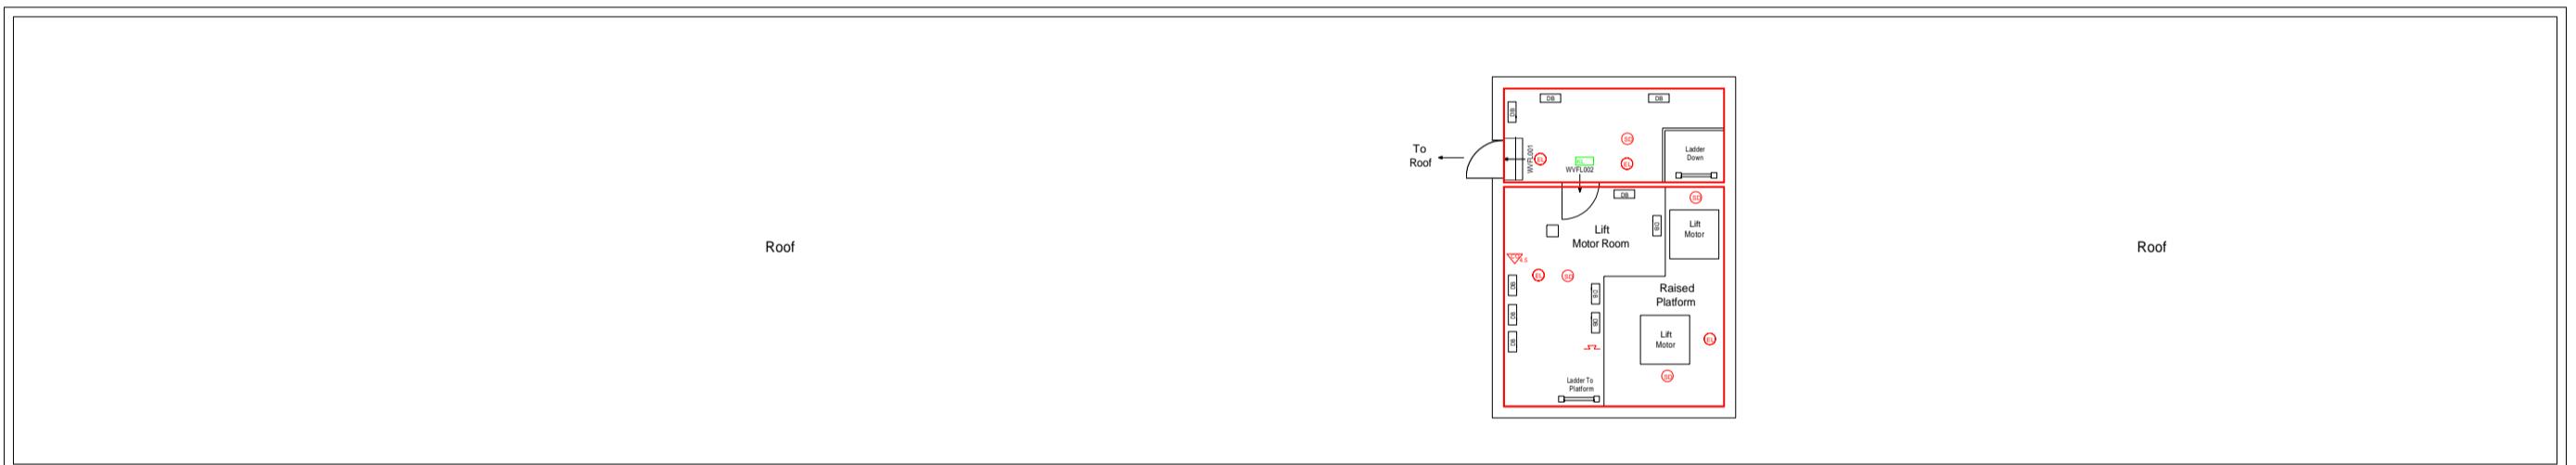

## LOFT



Scale Bar (Metres)



Firntec Building Compliance | www.firntec.com | info@firntec.com | 01752 977 147  
1st Floor, Endeavour House, 3 Parkway Court, Plymouth, PL6 8LR

#### Project Address

WEST VIEW COURT  
WEST VIEW ROAD  
NORTHENDEN  
M22 4LQ

#### Client:

WYTHENSHAWE COMMUNITY HOUSING GROUP

Scale:	Date:	Drawn by:	Checked by:
1:100 @ A1	JAN 2023	NR	NR

Drawing Title:  
LOFT FLOOR PLAN

Drawing No:	110 / 01 / 23	Revision	A
-------------	---------------	----------	---